

# Duct humidity transmitter high 0-10 V

**Article number: 803710 2023**

Our channel humidity transmitter High with 0-10 V voltage output offers a robust plastic housing with quick-release screws. The device reliably measures humidity and optionally temperature, with four switchable temperature measuring ranges available. The relative humidity is precisely recorded by a digital humidity sensor housed in a durable plastic sintered filter. The transmitter can be calibrated and enables fine adjustment for maximum accuracy. Installation is simple and is carried out directly in the ventilation duct using the mounting flange included in the scope of delivery.



Supply and output	
Output	0 - 10 V
Power consumption	< 1,1 VA / 24 V DC; < 2,2 VA / 24 V AC
Voltage supply	24 V AC (± 20 %)   15 - 36 V DC
Connection type	See connection diagrams

General information	
Load resistance	RI > 5 kOhm
Sensors	Digital humidity sensor, optionally with integrated temperature sensor
Process connection	by means of plastic mounting flange and mounting brackets


Humidity	
Measuring element humidity	Digital humidity sensor (low hysteresis, high long-term stability)
Measuring range humidity	0 % RH to 100 % RH
Output humidity	0-10 V
Accuracy humidity	± 2.0 % (20 % RH to 80 % RH) at +25 °C, otherwise ± 3.0 %
Long-term stability	± 1 % / year

Temperature	
Measuring element Temperature	Pt1000, DIN EN 60751, Class B
Measuring range temperature	Factory configuration: 0 °C to 50 °C multi-range switching with 4 switchable measuring ranges
Output temperature	0 - 10 V
Accuracy temperature	typically ± 0.2 K at +25 °C

Ambient conditions	
Storage temperature	-35 °C to +85 °C
Operating temperature	-30 °C to +70 °C
Permissible air humidity	< 95 % RH, non-condensing air

Certifications / Standards	
Protection class	III (according to EN 60 730)
Protection type	IP 65 according to EN 60 529
Standards	CE conformity electromagnetic compatibility according to EN 61326 according to EMC Directive 2014/ 30/ EU

**Configurable options**  
M - Measured variable

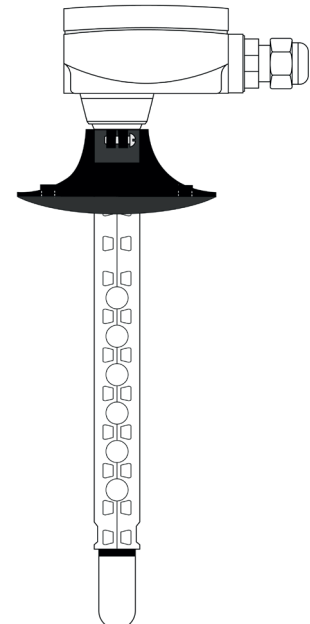

MW / KC / 05.09.2024

**Testo Sensor GmbH**

+49 7653 96597-71

Testo-Straße 1  
D-79853 Lenzkirch

webshop@testo-sensor.de

Please find our whole temperature probe and transmitter portfolio in our webshop at: [www.testo-sensor.shop](http://www.testo-sensor.shop)

Managing Director: Prof. Burkart Knospe, Martin Arndt, Timo Löffler

Amtsgericht Freiburg HRB 706025 | Umsatzsteuer-ID.: DE274417683

Housing	
Material	Plastic, UV-resistant Material polyamide, 30 % glass bead reinforced
Dimensions (L/W/H) (mm)	72 x 64 x 37,8
Color	Traffic white (similar to RAL9016)
Screw connection	Cable gland, Plastic, M16x1,5, Strain relief, replaceable, max. 10,4 mm Ø Inner
Electrical connection	0.14 - 1.5 mm <sup>2</sup> , via screw terminals on circuit board
Closure	with quick release screws

Probe shaft		Sensor protection (Included in delivery)	
Material	Polyamide	Material	Plastic sintered filter
Ø (mm)	20	Material	replaceable
Length (mm)	55	Material	Plastic
		Ø (mm)	16
		Length (mm)	32

Your order code			
Article number	Measured variable	code	Measured variable
803710 2023	---	M1	% RH (Relative humidity)
		M2	°C + % RH (Temperature and relative humidity)

Delivery and Packing	
Delivery	Transmitter, Plastic flange MF-20-K, Operating instructions
Packing	individually packed in cardboard box

**Plastic flange MF-20-K (Included in delivery)**

Material	Plastic
Mounting	2 x Ø 5,2 mm drill holes
Hole (mm)	Ø 20

MW / KC / 05.09.2024

**Testo Sensor GmbH**

+49 7653 96597-71  
 Testo-Straße 1  
 D-79853 Lenzkirch


Managing Director: Prof. Burkart Knospe, Martin Arndt, Timo Löffler  
 webshop@testo-sensor.de  
 Please find our whole temperature probe and transmitter portfolio in our webshop at: [www.testo-sensor.shop](http://www.testo-sensor.shop)

Amtsgericht Freiburg HRB 706025 | Umsatzsteuer-ID.: DE274417683

**Technical drawing**

**Configurable options**  
M - Measured variable

All dimensions in mm

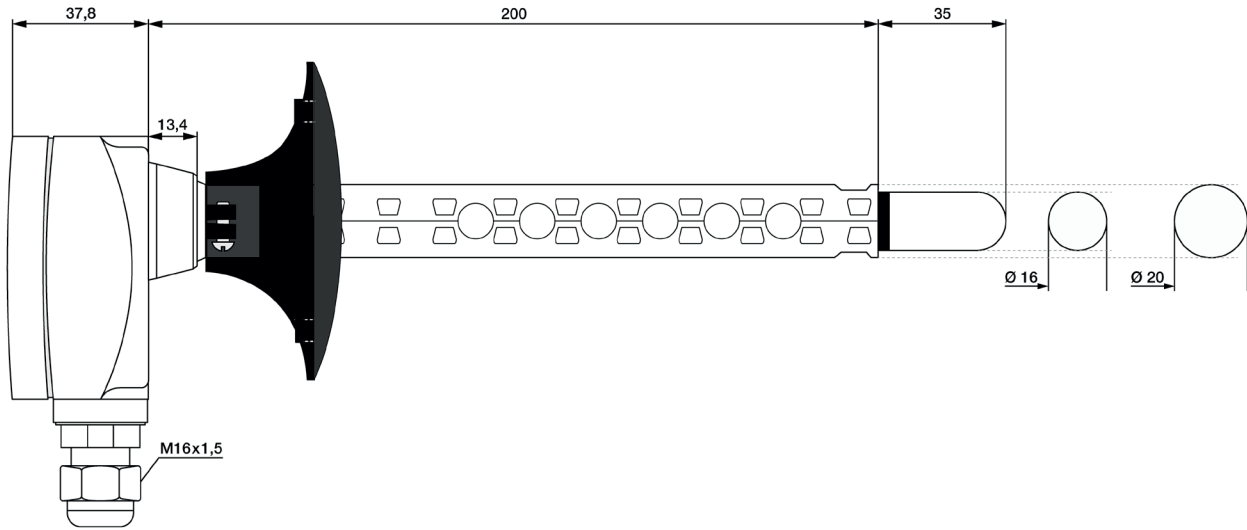


**Important assembly instructions**

Installation using the mounting flange (included in the scope of delivery): Please ensure that the  $\varnothing$  of the mounting flange matches the  $\varnothing$  of the protection sleeve.

To minimize measurement errors due to heat dissipation, place the probe shaft in the middle of the duct and make sure that the probe can be easily removed if necessary.

The device should only be used in pollutant-free, non-condensing air (< 95 % RH). The sintered filter protects the humidity sensor in outdoor and duct probes from dust, which can falsify the measurement result. Maintenance in the event of contamination is therefore important. Avoid touching the humidity element to prevent incorrect measurements.

When connecting several probes to a common 24 V AC power supply, pay attention to the polarity to avoid short circuits. Please note that the voltage outputs are short-circuit-proof, but an overvoltage or the application of the power supply to the voltage output can destroy the device.

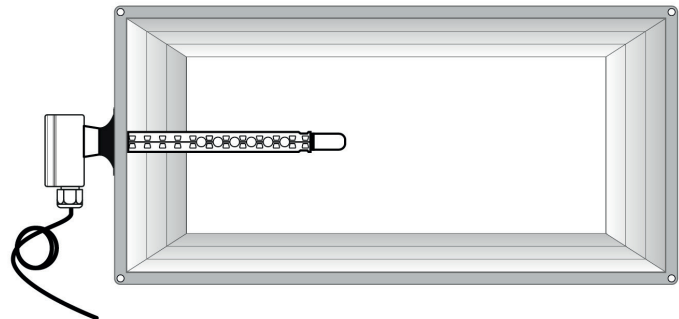

**Circuit diagrams and assignment (Please also read the operating instructions before connecting the transmitter)**

Default configuration	Set scaling via DIP switch	Wiring diagram	Assignment % RH															
Werkseinstellungen: Skalierung: 0 .. 50 °C 	Messbereichumschaltung via DIP-Schalter Changing measuring range via DIP switches <table border="1"> <thead> <tr> <th>DIP 1</th> <th>DIP 2</th> <th>Scaling Range</th> </tr> </thead> <tbody> <tr> <td>on</td> <td>on</td> <td>-35 .. +75°C</td> </tr> <tr> <td>off</td> <td>off</td> <td>-35 .. +35°C</td> </tr> <tr> <td>off</td> <td>on</td> <td>0 .. +50°C</td> </tr> <tr> <td>on</td> <td>off</td> <td>0 .. +80°C</td> </tr> </tbody> </table>	DIP 1	DIP 2	Scaling Range	on	on	-35 .. +75°C	off	off	-35 .. +35°C	off	on	0 .. +50°C	on	off	0 .. +80°C	DIP-Schalter Messbereichumschaltung DIP switches Measuring range changeover 	1 = +UB 24V DC 2 = Output Humidity 0-10 V 3 = free 4 = UB GND <b>Assignment °C + % RH</b> 1 = +UB 24V DC 2 = Output Humidity 0-10 V 3 = Output temperature 0-10 V 4 = UB GND
DIP 1	DIP 2	Scaling Range																
on	on	-35 .. +75°C																
off	off	-35 .. +35°C																
off	on	0 .. +50°C																
on	off	0 .. +80°C																
Temperature table in OI																		

Please observe the operating instructions for correct connection

MW / KC / 05.09.2024

**Testo Sensor GmbH**

+49 7653 96597-71      Managing Director: Prof. Burkart Knospe, Martin Arndt, Timo Löffler  
 Testo-Straße 1      webshop@testo-sensor.de      Amtsgericht Freiburg HRB 706025 | Umsatzsteuer-ID.: DE274417683  
 D-79853 Lenzkirch      Please find our whole temperature probe and transmitter portfolio in our webshop at: [www.testo-sensor.shop](http://www.testo-sensor.shop)


# Accessoires: Mounting flange

## Plastic flange MF-20-K



### Your order code

Article number	809500 8000
Material	Plastic
Mounting	2 x Ø 5,2 mm drill holes
Hole (mm)	Ø 20

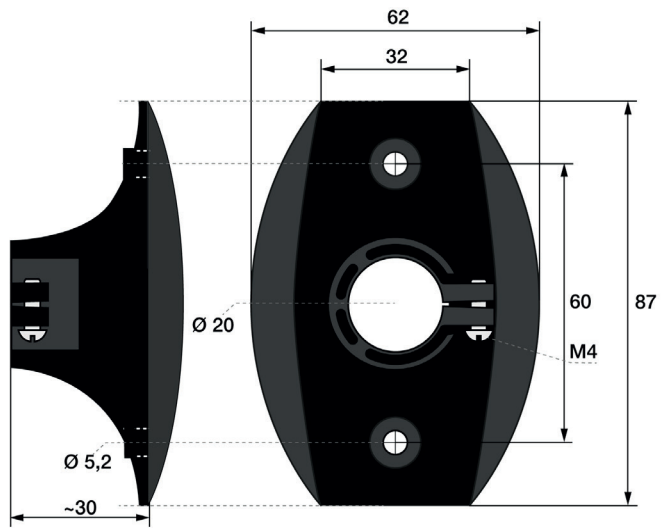

# Accessoires: Sintered filter

## Metal sintered filter

Article image	Your order code	Technical drawing
	<b>Article number</b>	<b>809990 0005</b>
	Material	Stainless steel 1.4404   316L
	Length (mm)	32
	Ø outside (mm)	16

## Plastic sintered filter

Article image	Your order code	Technical drawing
	<b>Article number</b>	<b>809990 0006</b>
	Material	Plastic
	Length (mm)	35
	Ø outside (mm)	16

MW / KC / 05.09.2024

### Testo Sensor GmbH

+49 7653 96597-71  
 webshop@testo-sensor.de  
 Testo-Straße 1  
 D-79853 Lenzkirch

Managing Director: Prof. Burkart Knospe, Martin Arndt, Timo Löffler  
 Amtsgericht Freiburg HRB 706025 | Umsatzsteuer-ID.: DE274417683  
 Please find our whole temperature probe and transmitter portfolio in our webshop at: [www.testo-sensor.shop](http://www.testo-sensor.shop)